


- NOTES:
- 1) HINGE, HASP, ANCHOR BRACKETS & BOLTS ARE T-304 S.S.
 - 2) THE MANHOLE BARREL IS 1/2" (MINIMUM) THICK FRP.
 - 3) NEOPRENE BOOTS ARE SECURED WITH S.S. BANDS.
 - 4) THE MATERIAL IS FRP (FIBERGLASS REINFORCED POLYESTER).

NOTE:
RECOMMEND CONTRACTOR TO FILL
MANHOLE WITH CONCRETE OR SAND
COVERED WITH CONCRETE TO THE
TOP OF THE FLUME.



**6" PARSHALL FLUME
PACKAGED METERING MANHOLE
5' - 0" DIA.**

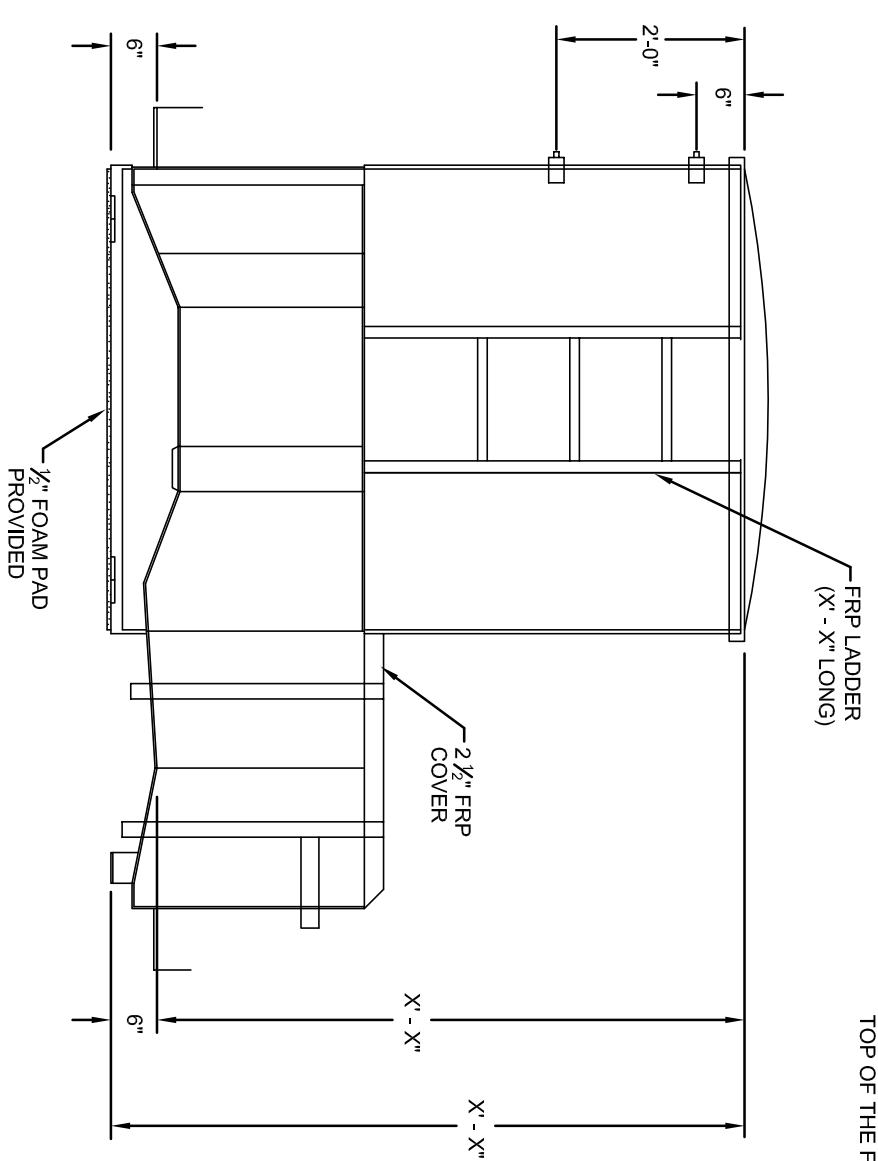

BUTLER COUNTY
WATER AND SEWER

130 HIGH STREET
HAMILTON, OH 45011
TELEPHONE: 513-887-3066
FAX: 513-887-3777

PLASTI-FAB
TUALATIN, OREGON